


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

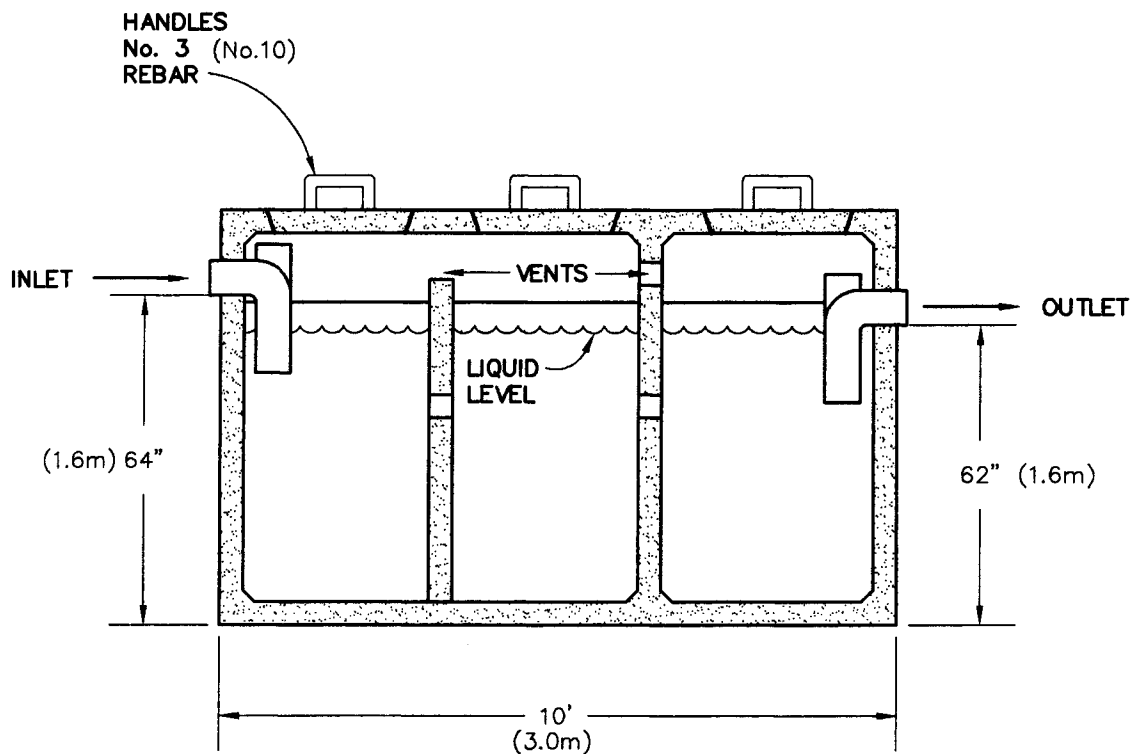

LONGITUDINAL SECTION

NOTE:
THE OIL INTERCEPTOR IS SIZED IN ACCORDANCE WITH PEAK VOLUME OF WASTE IN GALLONS PER MINUTE THAT SHOULD BE DISCHARGED THROUGH THE DRAINAGE SYSTEM SERVED BY THE INTERCEPTOR. OIL INTERCEPTORS MAY BE CONSTRUCTED OF REINFORCED CONCRETE, CAST IRON, OR FABRICATED STEEL.

DRAWN BY: C.A.C.	CITY OF PASO ROBLES ENGINEERING DIVISION	DRAWING NO.
DESIGNED BY:		
DATE: 4/18/94	OIL INTERCEPTOR	F-8
FILE NAME: PR-F-8.DWG		